

# What is ISA108 About ?

---



- How is ISA-108 structured ?
- Why are iSA-108 Intelligent device management (IDM) standards needed ?
- Can existing automation systems Solve these problems ?
- Proposed Owner/Operator's Critical Information Repository (CIR).
- Proposed Work Process standards.
- Integration with other “Risk Based” standards.
- What is new and useful about iSA-108 ?

# How is ISA108 Structured ?

---



ISA 108 describes how to apply Intelligent industrial Devices (IIDs) including the Design, Operation and Maintenance of control & Information systems that contain them.

- **Part 1** describes **concepts**, models, and terminology. This section was Issued as ISA108 and is close to submission as IEC 63082-1.
- **Part 2** is being drafted, and will contain normative content (**what to do**).
- **Part 3** will contain implementation guidelines (**how to do it**) including Work Processes, Procedures and Tasks and who should execute these.
- **Part 4** will contain implementation **examples** including vertical industry examples (like oil refining) or product type examples (such as control valves).

# Why is ISA 108 Standard Needed?

3

Intelligent Industrial Devices (IIDs) can bring significant benefits by reducing spares and predicting failures, however very little of this potential has been realized.

Major implementation problems include:

- Added complexity has meant that IIDs are often never fully implemented or adequately maintained.
- Vendors have failed to supply, support and update communication and configuration software, particularly for other's products.
- There are examples of industrial disasters costing \$ billions that have involved IID Implementation failures.
- Unnecessary shutdowns costing \$ millions have been caused by failure to use available IID Health and Diagnostic information.

# Why is ISA-108 Standard Needed?

4

As IIDs become more complex, management of associated data and design decisions is increasingly difficult.

- IIDs may require selecting and maintaining hundreds or even thousands of data values whose sheer volume is challenging
- The reasons for design choices is often lost between Engineering and Operations.
- Tag and Loop Data may be corrupted as it is passed between incompatible Engineering design systems, Construction systems, Operations and Maintenance systems.
- Plant maintenance often cannot determine whether “like-for-like” replacement of IIDs is possible.

# Why is ISA-108 Standard Needed?

5

Many companies have found that accuracy of IID configuration deteriorates with time, with configuration errors in 30% or more of their devices after a few years of operation.

- Configuration errors may include:
  - Simple Mistakes – special technician training and/or certification for IIDs is not recognized or prioritized (unlike welding for example).
  - Quick Fixes – *Hand-held programing devices facilitate “ad-hoc” modifications, but a “back shift” change may stay for years.*
  - Uncoordinated Changes – Field devices may be changed without updating higher level systems (e.g. DCS, SCADA, SAP, etc.)
  - Undocumented Changes – Hand-held programmers may be used to *change configurations without updating central “approved” records.*
  - Lack of Consistency – IID replacement or repair procedures are often not documented or enforced.

# Why is ISA-108 Standard Needed?


6

IIDs often require support from the supplier, or specialist services contractors, for example:

- Custody transfer meters that require regular certification or monitoring
- Sophisticated diagnostic devices like vibration analyzers that require specialists to interpret
- Boiler Stack Gas Analyzers (e.g. boiler optimizer services offered remotely)

However for cyber security reasons, site personnel are reluctant to allow remote access as there is little guidance on how to manage access to these devices.

# Can Existing Engineering Automation Tools Solve the “Data Management” Problem ?

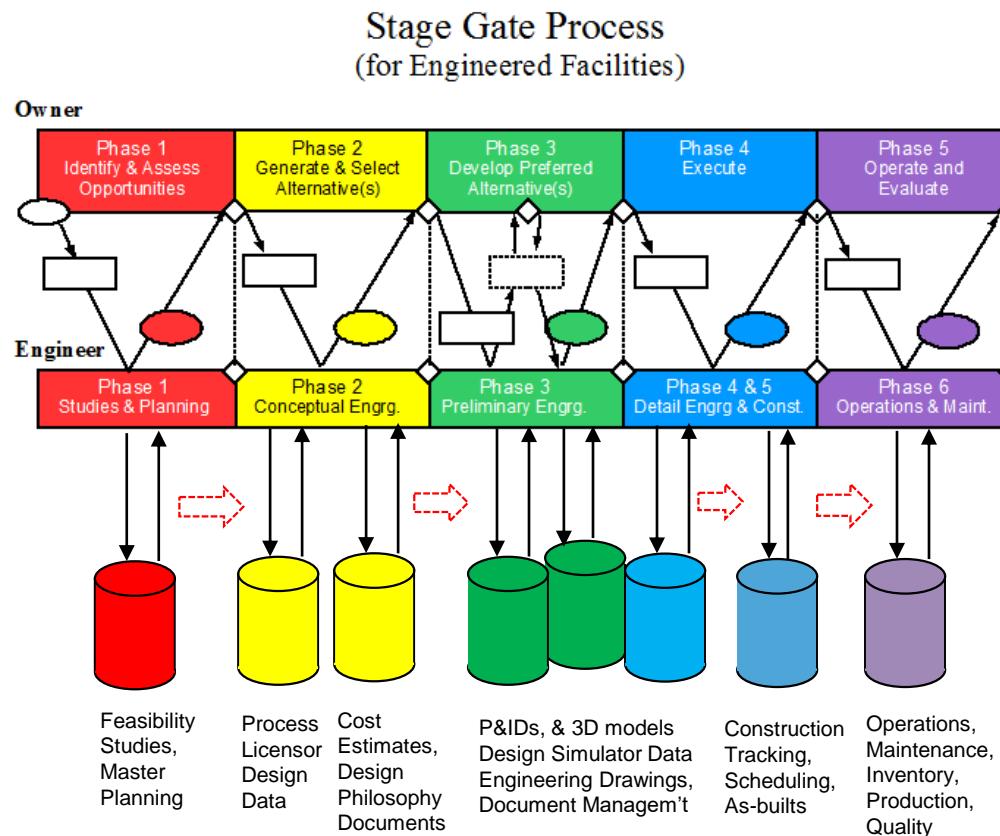

Data is developed in “silos” and is often not effectively transferred between Engineering, Construction & Operating Phases

# Can Existing Engineering Automation Tools Solve this Problem ?


---



The large volume of project data requires use of automation tools (e.g. CADD, Databases, Modeling, etc.). Large projects MUST use them, so ISA 108 requirements MUST integrate with these tools as well as “traditional” engineering procedures.

- However, the existing automation tools used in each Phase and by each Discipline are usually different and incompatible.
- *Existing automation tools provide no “single source” of approved design information.*
- Thus, existing automation tools actually make IDM data transfer between Phases and Organizations even more difficult, time consuming & expensive.

# “Critical Information Repository” Is an Example IID Data Management Solution

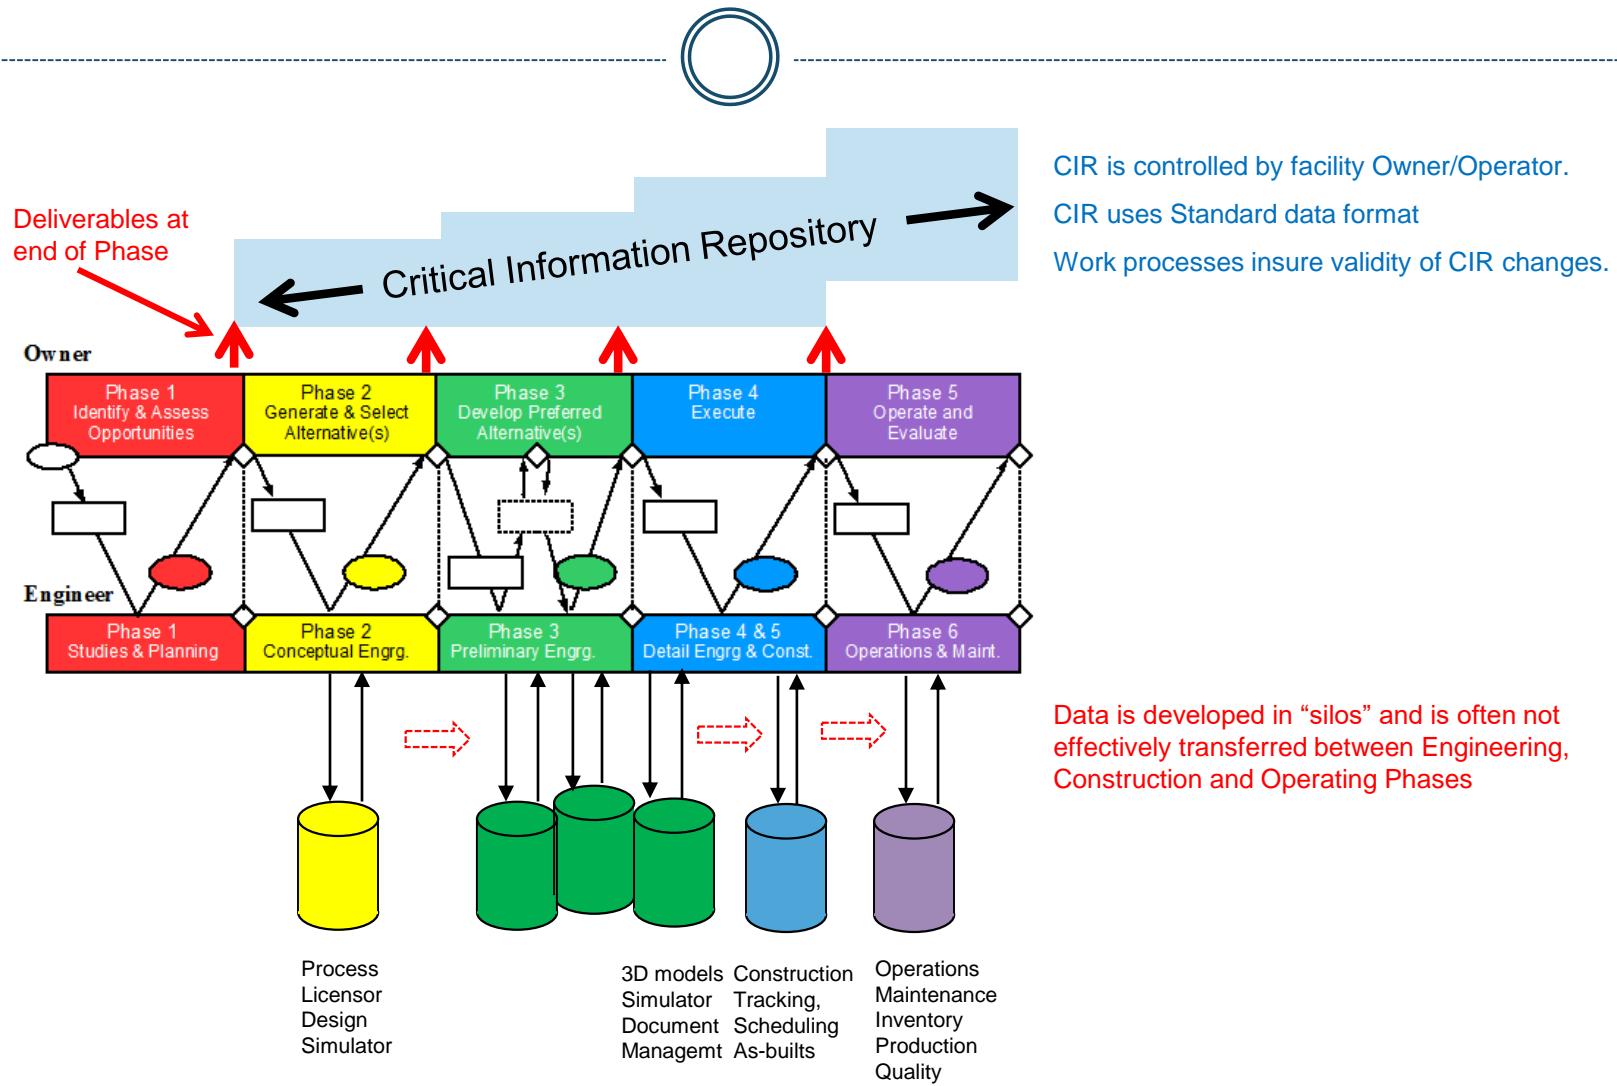

# Example CIR IID Data Management Solution

---



This Critical Information Repository (CIR) will be the responsibility of the Owner/Operator and will span all Enterprise Phases.

CIR will hold at least the key information on all “High Risk” or “High Impact” Intelligent Devices (including SIS/SIL & CyberSecurity).

The CIR data will be uploaded at the end of each enterprise Phase (contractual requirement from all subcontractors).

Loading IID data to the CIR, and changes to approved CIR data requires formal work processes, including technical & management approvals (Engineering Change Control).

Consistent Engineering Data formats (e.g. STEP) and Multi-vendor field communication protocols (e.g. FDI) are required.

# Example CIR IID Data Management Solution

---



An audit of CIR data is required at end of each enterprise phase, and after major maintenance turnarounds and upgrades.

The CIR will provide a full historical record for each “Service Tag, including:

- Original approved design basis, specifications, configuration data /information, etc.
- *Design changes with reasons and approvals (including “As-builts”)*
- Maintenance events including failures and in-kind replacements
- Modifications by maintenance and site engineering, including approved designs and approvals.
- Current approved configuration (for comparison with active field configuration).

# Other IID CIR Implementation Alternatives

---



There are many ways that a CIR could be implemented ranging from simple to sophisticated, depending on the scale and complexity of the facility or enterprise.

- A small liquid storage and loading site with a few dozen tags might use a spreadsheet or even a paper system (file cabinet).
- A *centralized “internal cloud” database might be implemented to support multiple large facilities such as refineries or pipelines.*
- A *“block chain” or a “mediated” system might enforce Engineering Management of Change as part of an “Asset Management System.*
- Whatever technology is chosen, it must be implemented as part of a coordinated Intelligent Device Management (IDM) program.

# What do ISA 108 Work Processes look like ?



They are similar to existing engineering and maintenance Work Processes and may vary in detail and format as determined by each Enterprise.

Work processes are divided into “Pools” by Phase and Stakeholder

Pools are Divided into “Swim-lanes” by Role within the Stakeholder organization.

Swim-lanes are divided into Procedures that produce Deliverables (like Drawings, Work Permits, etc.)

Procedures are composed of Tasks that are assigned to one person and can be completed without management supervision. In some cases, certified qualifications are required for the person who performs a Task.

Interfaces are defined between Pools, Swim-lanes, Procedures and Tasks


Various Forms, Checklists, Standard Designs and Documents, etc., may be used by Pools, Swim-lanes, Procedures and Tasks.

## “Work Process Diagrams” for Stakeholders involved with Intelligent Device Configuration and Change Control

	Study / Program / Master Planning	Conceptual Engrg	Preliminary Engrg / FEED	Detail Engrg	Construction	Operations / Maintenance
Owner / Operator						
EPC Contractor		<p>Interface to PM Swim Lane</p> <p>Interface to other Task</p> <p>Interface to Contract Mgr Swim Lane</p>				
Vendor / Support						

- Each “cell” above represents a Work Process “Pool” for one Enterprise Phase (e.g. Preliminary Engrg/FEED) and one “Stakeholder” (such as an Owner/Operator, EPC or a Vendor).
- Each Pool may have several “Swimlanes” for Roles associated with that Stakeholder during that Phase (e.g. Control Engineer, Engineering Mgr, Contract Mgr., etc.)
- Each Swimlane (Role) includes multiple Procedures and each Procedure is approved by a single “Role Manager”.
- Procedures are typically associated with “Deliverables” although there may be more than one Deliverable per Procedure or more than one Procedure per Deliverable. Deliverables are formally approved and “issued”.
- Each Procedure includes one or more Tasks (which are accomplished by an individual without supervision).
- A Task must be assigned to an individual that is responsible for its completion, even though the assistance of others may be required (e.g. a Task may be assigned to a Supervisor).
- Tasks or Procedures may have “interfaces” to other Tasks, Procedures or Swimlanes
- Interfaces between Tasks are informal, between Swim Lanes are Proceduralized, and between Pools are formal.

# Example Control System Procedures & Deliverables

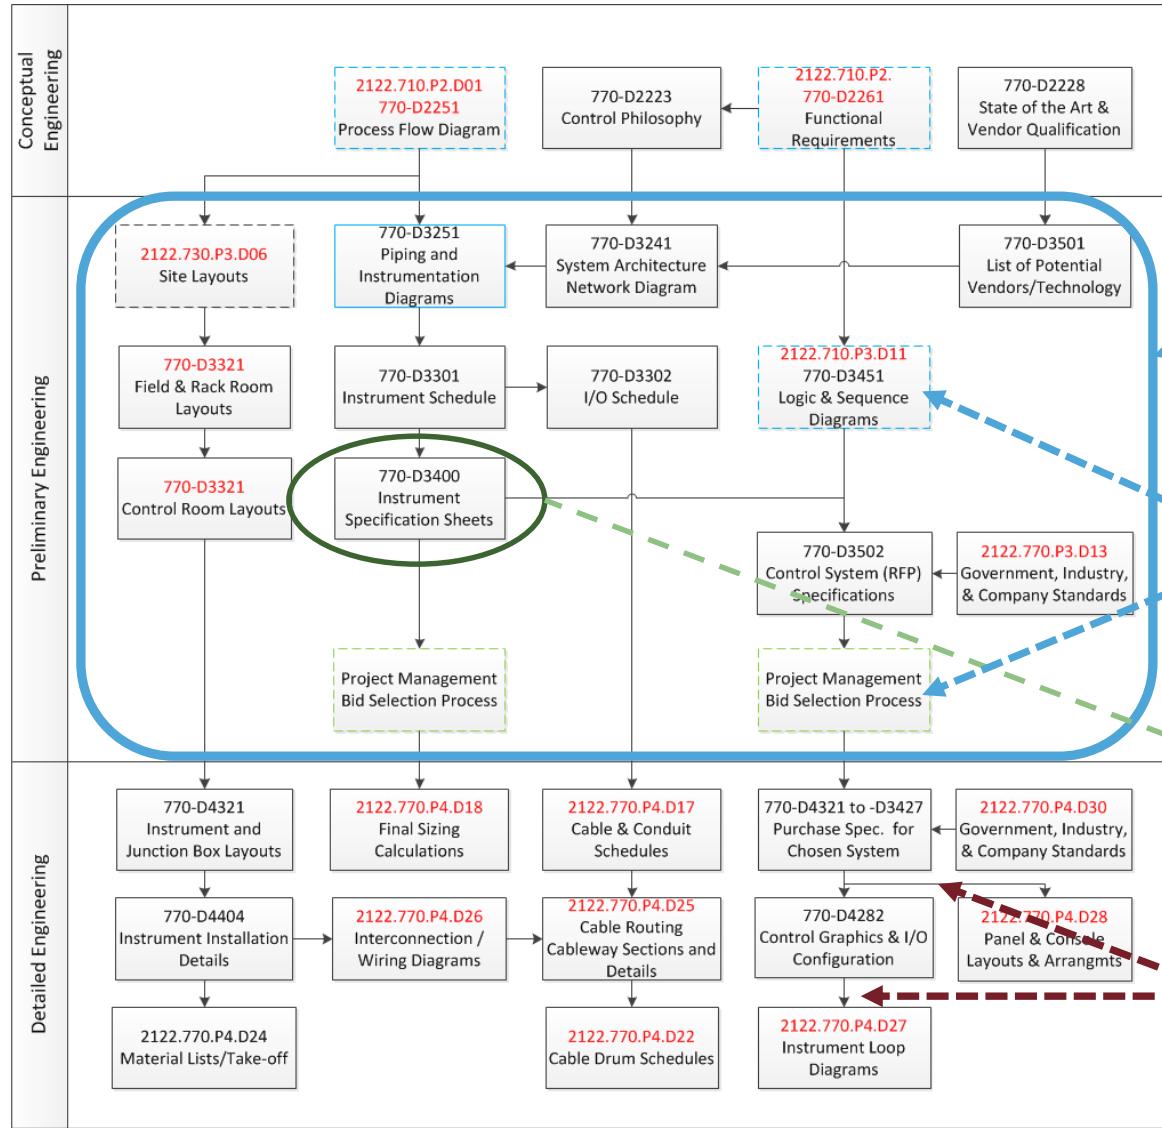

Control Systems Swim Lane for Preliminary Engineering

Interfaces to other Swimplanes (Process Engrg & Project Management)

Control Systems Preliminary Engineering Procedure

Deliverables will be connected with Procedures and Work Processes.

# Each Deliverable may have:



Each Deliverable may have associated Work Processes, Procedures and Tasks, and these may in turn have:

- Forms (e.g. ISA-12 Specification Sheets)
- Work Flow Diagrams
- Example Drawings, “Go-by” Documents, Reference Designs, etc.
- Metrics including KPIs

ISA 108 will use standard Engineering forms such as ISA Instrument Specification Sheets or API Pump Sheets as a base, but will add additional data.

Deliverables may be eliminated and the associated Procedures, Forms, etc. will also be deleted.


## Using an IID May add Hundreds of Data Elements to the Instrument Specification




	Project			DATA SHEET		
	Unit			SPEC		
	P.O.			TAG		
	Item			DWG		
	Contract			SERVICE		
	MFN Serial			DATE		
1	Fluid	Crit Pres PC				
2	SERVICE CONDITIONS	Flow Rate	Units	Max Flow	Norm Flow	
3		Inlet Pressure			Min Flow	
4		Outlet Pressure			Shut-Off	
5		Inlet Temperature				
6		Spec Wt/Spec Grav/Mol Wt				
7		Viscosity/Spec Heats Ration				
8		Vapor Pressure P <sub>v</sub>				
9		*Required C <sub>v</sub>				
10		*Travel				
11		Allowable/*Predicted SPL				
12						
13	LINE	Pipe Line Size	In	53	*Type	
14		& Schedule	Out	54	*Mfr & Model	
15		Pipe Line Insulation		55	Norrisel	
16		*Type		56	*Size	
17		*Size		57	Eff Area	
18		Max Press/Temp		58	On/Off	
19		*Norrisel Model		59	Modulating	
20		*Body/Bonnet Matl		60	Spring Action Open/Close	
21		*Liner Material/ID		61	*Max Allowable Pressure	
22		End In		62	*Min Required Pressure	
23		Connection/Out		63	Available Air Supply Pressure	
24		Flg Face Finish		64	Max	
25	End Ext/Matl		65	Min		
26	*Flow Direction		66	Bench Range		
27	*Type of Bonnet		67	Act Orientation		
28	Lub & Iso Valve		68	Vertical		
29	*Packing Material		69	Handwheel Type		
30	*Packing Type		70	Air Failure Valve		
31	Seals/Gaskets		71	Set At		
32	VALVE BODY/BONNET	*Type		68	Input Signal	
33		*Size		69	*Type	
34		*Characteristic		70	*Mfr & Model	
35		*Balanced/UnBalanced		71	*On Incr Signal Output Incr/Decr	
36		*Rated C <sub>v</sub>	F <sub>1</sub>	X <sub>+</sub>	72	Gauges
37		*Plug/Ball/Disk Material			73	By-Pass
38		*Seat Material			74	*Cam Characteristic
39		*Cage/Guide Material			75	POSITIONER
40		*Stem Material			76	Type
41		NACE Required?			77	*Mfr & Model
42					78	Contacts/Rating
43					79	Actuation Points
44				80	NEMA Rating	
45				81	AIR SET	
46				82	*Mfr & Model	
47	Specials/Accessories			83	*Set Pressure	
48				84	Filter	
49				85	Gauge	
50				86		
51				87		
52				88		
				89	TESTS	
				90	*Hydro Pressure	
				91	ANSI/FCI Leakage Class	
				92		
				93		
				94		
				95		
				96		
				97		
				98		
				99		
				100		
				101		
				102		
				103		
				104		
				105		
				106		
				107		
				108		
				109		
				110		
				111		
				112		
				113		
				114		
				115		
				116		
				117		
				118		
				119		
				120		
				121		
				122		
				123		
				124		
				125		
				126		
				127		
				128		
				129		
				130		
				131		
				132		
				133		
				134		
				135		
				136		
				137		
				138		
				139		
				140		
				141		
				142		
				143		
				144		
				145		
				146		
				147		
				148		
				149		
				150		
				151		
				152		
				153		
				154		
				155		
				156		
				157		
				158		
				159		
				160		
				161		
				162		
				163		
				164		
				165		
				166		
				167		
				168		
				169		
				170		
				171		
				172		
				173		
				174		
				175		
				176		
				177		
				178		
				179		
				180		
				181		
				182		
				183		
				184		
				185		
				186		
				187		
				188		
				189		
				190		
				191		
				192		
				193		
				194		
				195		
				196		
				197		
				198		
				199		
				200		
				201		
				202		
				203		
				204		
				205		
				206		
				207		
				208		
				209		
				210		
				211		
				212		
				213		
				214		
				215		
				216		
				217		
				218		
				219		
				220		
				221		
				222		
				223		
				224		
				225		
				226		
				227		
				228		
				229		
				230		
				231		
				232		
				233		
				234		
				235		
				236		
				237		
				238		
				239		
				240		
				241		
				242		
				243		
				244		
				245		
				246		
				247		
				248		
				249		
				250		
				251		
				252		
				253		
				254		
				255		
				256		
				257		
				258		
				259		
				260		
				261		
				262		
				263		
				264		
				265		
				266		
				267		
				268		
				269		
				270		
				271		
				272		
				273		
				274		
				275		
				276		
				277		
				278		
				279		
				280		
				281		
				282		
				283		
				284		
				285		
				286		
				287		
				288		
				289		
				290		
				291		
				292		
				293		
				294		
				295		
				296		
				297		
				298		
				299		
				300		
				301		
				302		
				303		
				304		
				305		
				306		
				307		
				308		
				309		
				310		
				311		
				312		
				313		
				314		
				315		
				316		
				317		
				318		
				319		
				320		
				321		
				322		
				323		
				324		
				325		
				326		
				327		
				328		
				329		
				330		
				331		
				332		
				333		
				334		
				335		
				336		
				337		
				338		
				339		
				340		
				341		
				342		
				343		
				344		
				345		
				346		
				347		
				348		
				349		
				350		
				351		
				352		
				353		
				354		
				355		
				356		
				357		
				358		
				359		
				360		
				361		
				362		
				363		
				364		
				365		
				366		
				367		
				368		
				369		
				370		
				371		
				372		
				373		
				374		
				375		
				376		
				377		
				378		
				379		
				380		
				381		
				382		
				383		
				384		
				385		
				386		
				387		
				388		
				389		
				390		
				391		
				392		
				393		
				394		
				39		

As with other Spec Sheet data, fields may be filled in by different Roles (e.g. Process Engr. or Controls Engr.), and during different Phases.


For more information, see OGI Pilot Spec Sheets

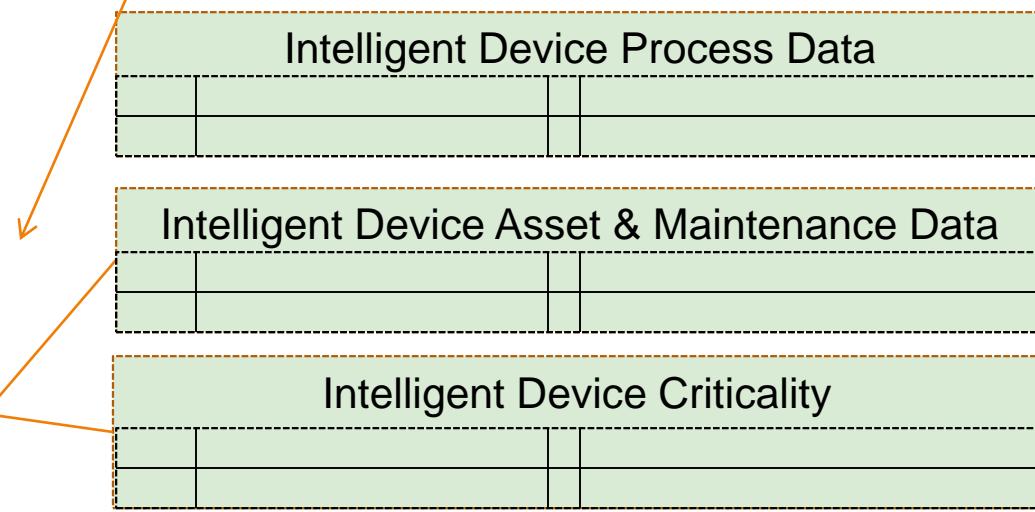

# Data is Delivered to Owner/Operator at the end of each Enterprise Life Cycle Phase

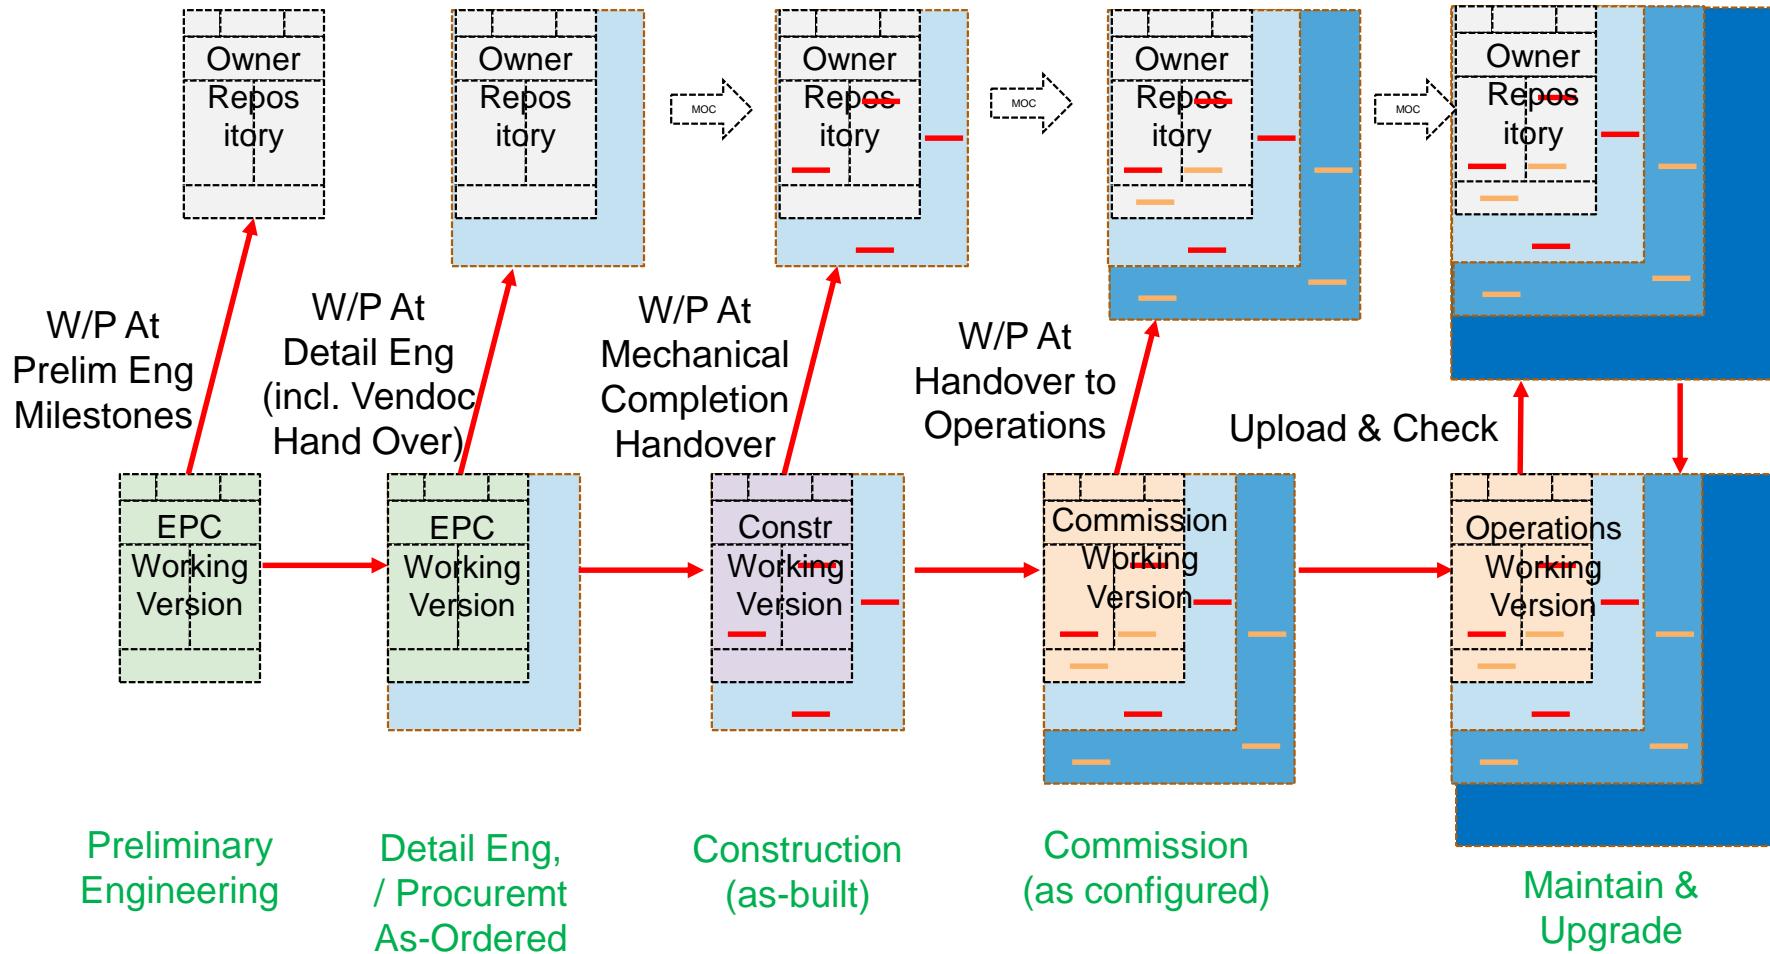

# Development of IID Data During Each Phase

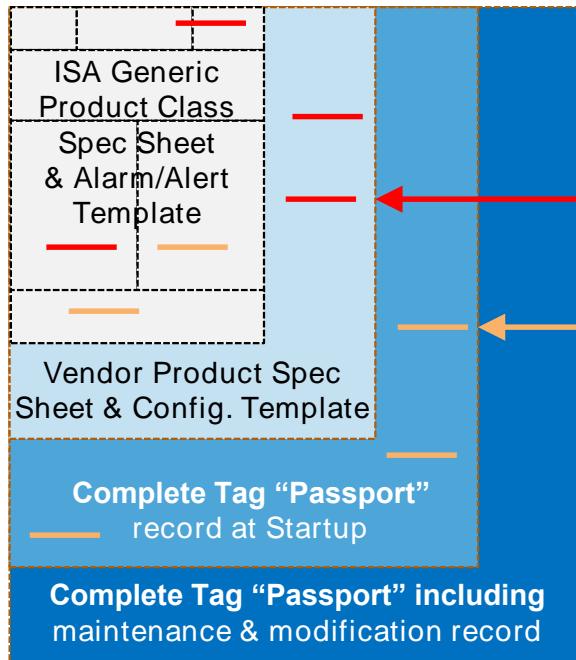

Colored lines indicate changes

- 1) by EPC during Engineering and Construction Phases,
- 2) by Owner at hand-over at the end of each Phase, and
- 3) possibly at milestones during each phase.
- 4) Note that once accepted to the CIR, changes cannot be made without an auditable Engineering Management of Change procedure.

# Integration of Other Risk-based Engineering Standards and Work Processes

---



- ISA 108 must integrate with existing control system standards and associated Work Processes, including:
  - ISA 84 (Safety Instrumented Systems),
  - ISA 95 (moving control domain data to MES)
  - ISA 99 (Industrial Cyber Security),
  - ISA 100 (Industrial radio LANs, etc.)
- ISA 108 is structured to be similar to ISA 84 to facilitate management of intelligent SIS/SIL devices and use by control engineers familiar with ISA 84, etc.

# Integration of Other Risk-based Engineering Standards and Work Processes



- ISA 108 uses a similar Risk Assessment methodology. When the risk of a certain device is assessed, it could be:
  - a safety system that must work very reliably (ISA 84),
  - a cyber security risk (ISA 99) or
  - a risk of major financial loss that could be prevented by IED maintenance monitoring and diagnostics (ISA 108).

RISK ASSESSMENT MATRIX				
SEVERITY PROBABILITY	Catastrophic (1)	Critical (2)	Marginal (3)	Negligible (4)
Frequent (A)	High	High	High	Medium
Probable (B)	High	High	Medium	Medium
Occasional (C)	High	Medium	Medium	Low
Remote (D)	Medium	Medium	Low	Low
Improbable (E)	Medium	Low	Low	Low

# Integration of Other Risk-based Engineering Standards and Work Processes

---



- The same risk assessment Procedure can decide if a risk requires ISA 84, 99 or 108 (or possibly all three).
- If ISA 84 or 99 are required, the user is referred to the appropriate standard, however, neither of these define the full set of IDM requirements (and IIDs are usually involved).
- ISA 108 procedures may then refer the user to appropriate other standards, and/or require procedures defined in ISA 108.
- *An Alarm/Alert “Template” (with appropriate “defaults”) will be automatically determined from the Risk Assessment. Correctly selected defaults should dramatically reduce the “Alarm/Alert Flood” experienced when vendors “turn on everything” by default.*

# What is New and Useful about ISA 108 ?



## ISA 108 will provide:

- Standardized Work Processes/Procedures/Tasks for managing the continuity of IDM information through all phases from design to operations and maintenance.
- Standardized Tasks (within Work Processes) requiring special training and certification.
- Examples of Roles associated with Work Processes and Tasks, and interfaces between Roles including “Swim Lane Charts” and Work Flow Diagrams. These examples (and those that follow) will be structured by “Industry” (e.g. Oil Fields or Pipelines) or Technology (e.g. Smart Valves).
- Example(s) of how a Critical Information Repository can be used by the Owner/Operator to manage IID Information.
- Example standard formats for Engineering data (e.g. STEP, ISO, etc.) to be defined in the Enterprise IDM Program.

# What is New and Useful about ISA 108 ?

---



## ISA 108 will provide:

- Example procedure for regular upload and comparison of actual Field Device Configuration and Authorized version (in CIR).
- Examples of use of standard multi-vendor field device communication protocols (e.g. FDI, OPC UA, etc.) to be used in the Enterprise IDM Program.
- Work Processes for Management of Change (MoC) for IID Information during Engineering and Operations Phases.
- Requirements and examples for setup of an IDM Program and ongoing management of such a Program.
- KPI's and Audit requirements for Intelligent Device Management Programs.

# What is New About ISA 108 ?

---



ISA 108 will provide:

- Risk-based Work Processes that integrate with other engineering standards, and eliminate Alarm/Alert “flooding” early in design.
- A way for maintenance to immediately determine whether they may immediately replace an IID “like-for-like” or only after engineering”.
- A way to facilitate “handover” of information between Phases (especially between Project and Operations phases).
- A way to detect and address inadvertent changes in IDM configuration and/or Facility Design Parameters at any Phase.
- Implementation examples for different industries